


HOSEBED CAPACITIES

① 1000' OF 4.00" LDH

② 800' OF 2.50" D.J. HOSE

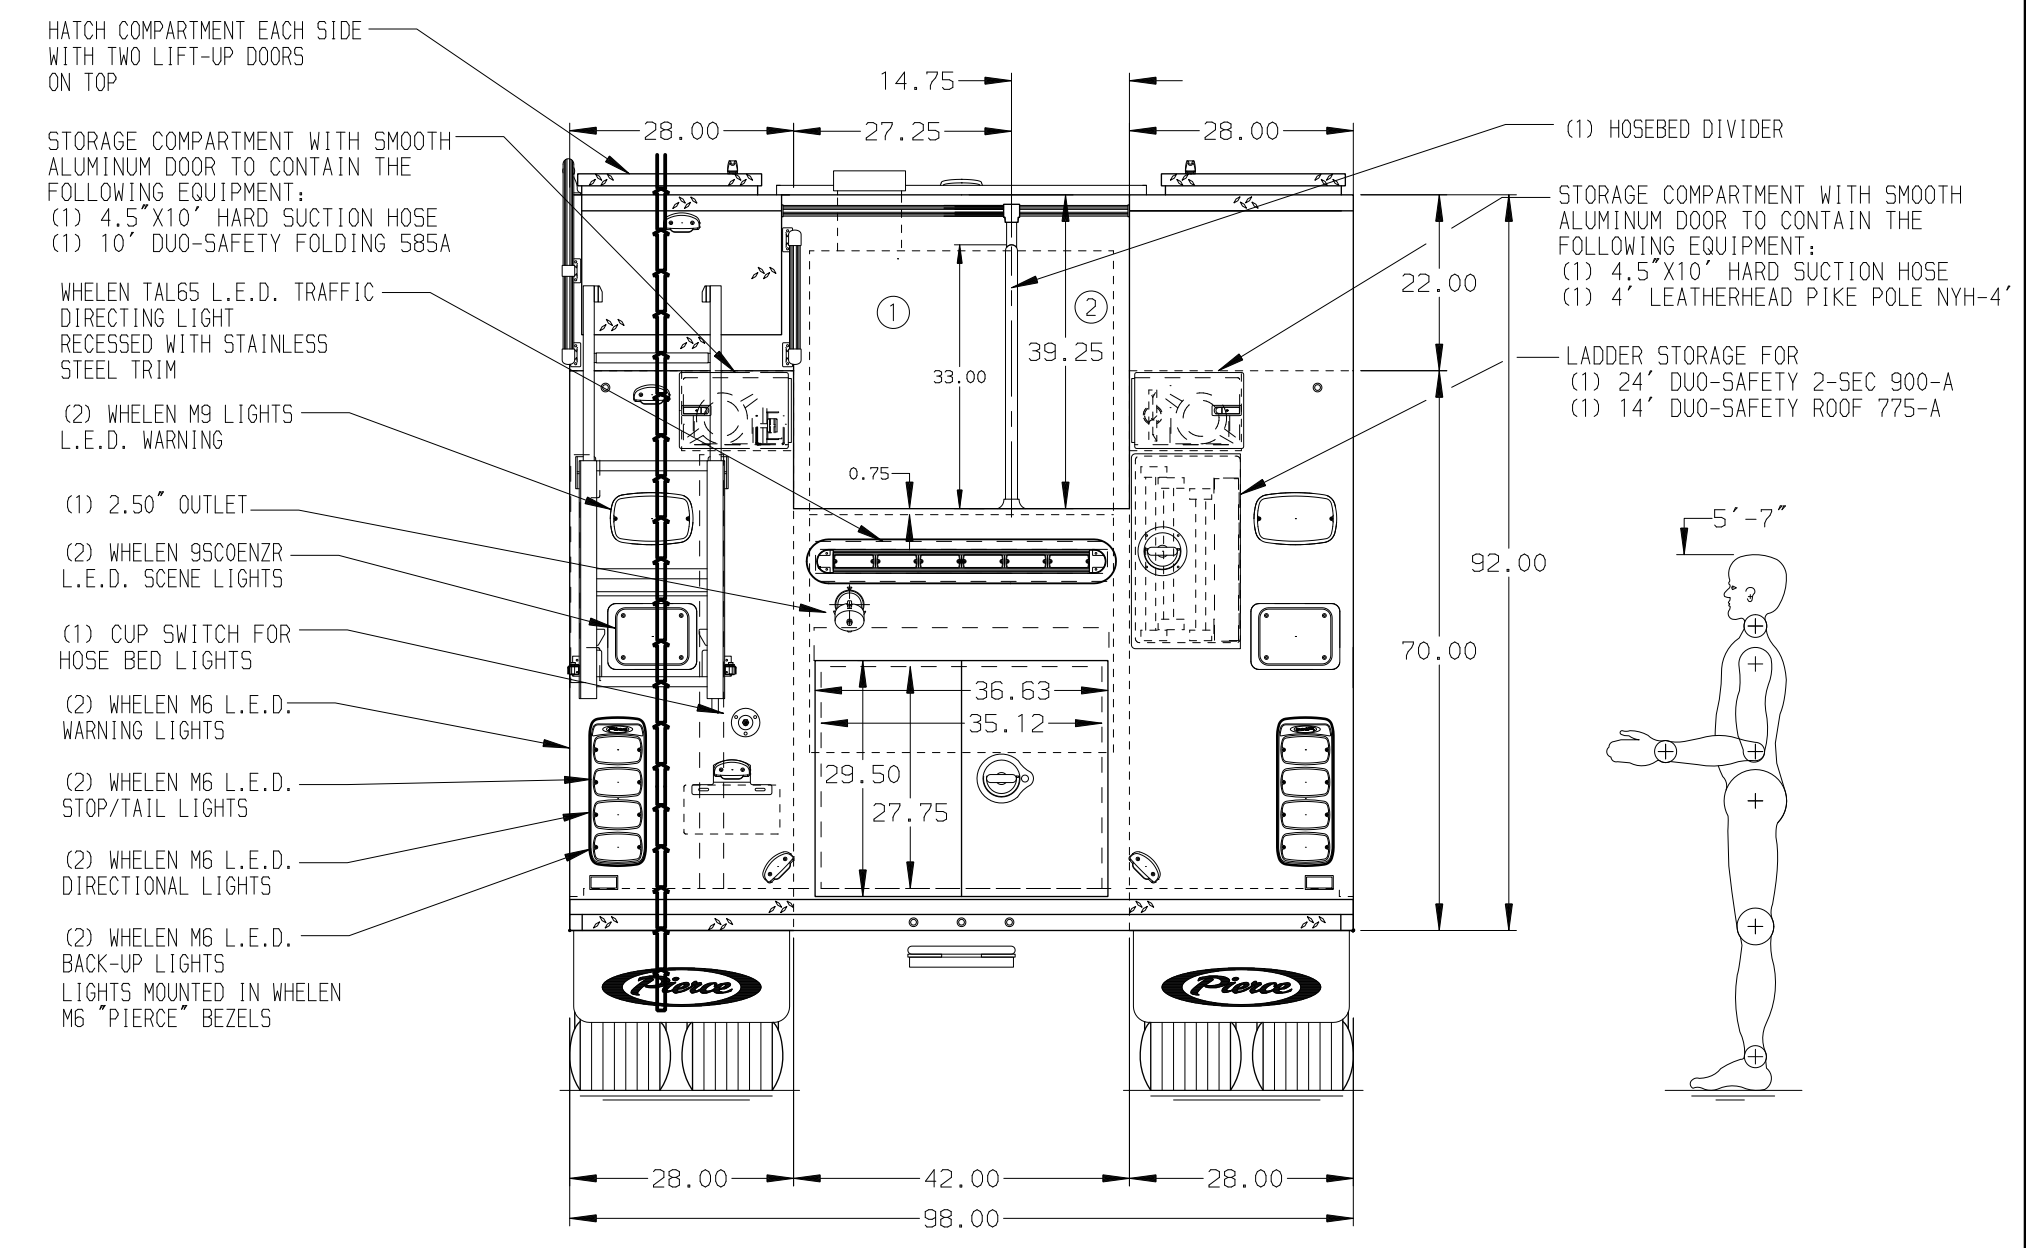

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

1. MOUNTING BRACKETS AND CHOCKS PROVIDED BY FIRE DEPARTMENT
2. BATTERY CHARGE INDICATOR LOCATED NEAR DRIVER'S SEAT RISER WITH BRACKET
3. AIR INLET WITH DISCONNECT COUPLING LOCATED IN DS STEP WELL

CUSTOMER APPROVAL

APPROVED BY:	
DATE:	
CHASSIS DATA	TITLE
MAKE	FOR
PIERCE	DWG NO.
MODEL	
VELOCITY FR	



1500-D-1000P, 960G WATER W/40G FOAM, 177" HDRP (3)CROSSLAYS, HUSKY 3, LADDERS THRU BODY

CENTRAL ARIZONA FIRE MEDICAL PRESCOTT VALLEY, ARIZONA

37278AD-SH1

JOB NO.	37278
SCALE	1:24
DATE	
DRAWN BY	LME
CHECKED BY	JJR
SHEET SIZE	D
SHEET NO.	1 OF 2