
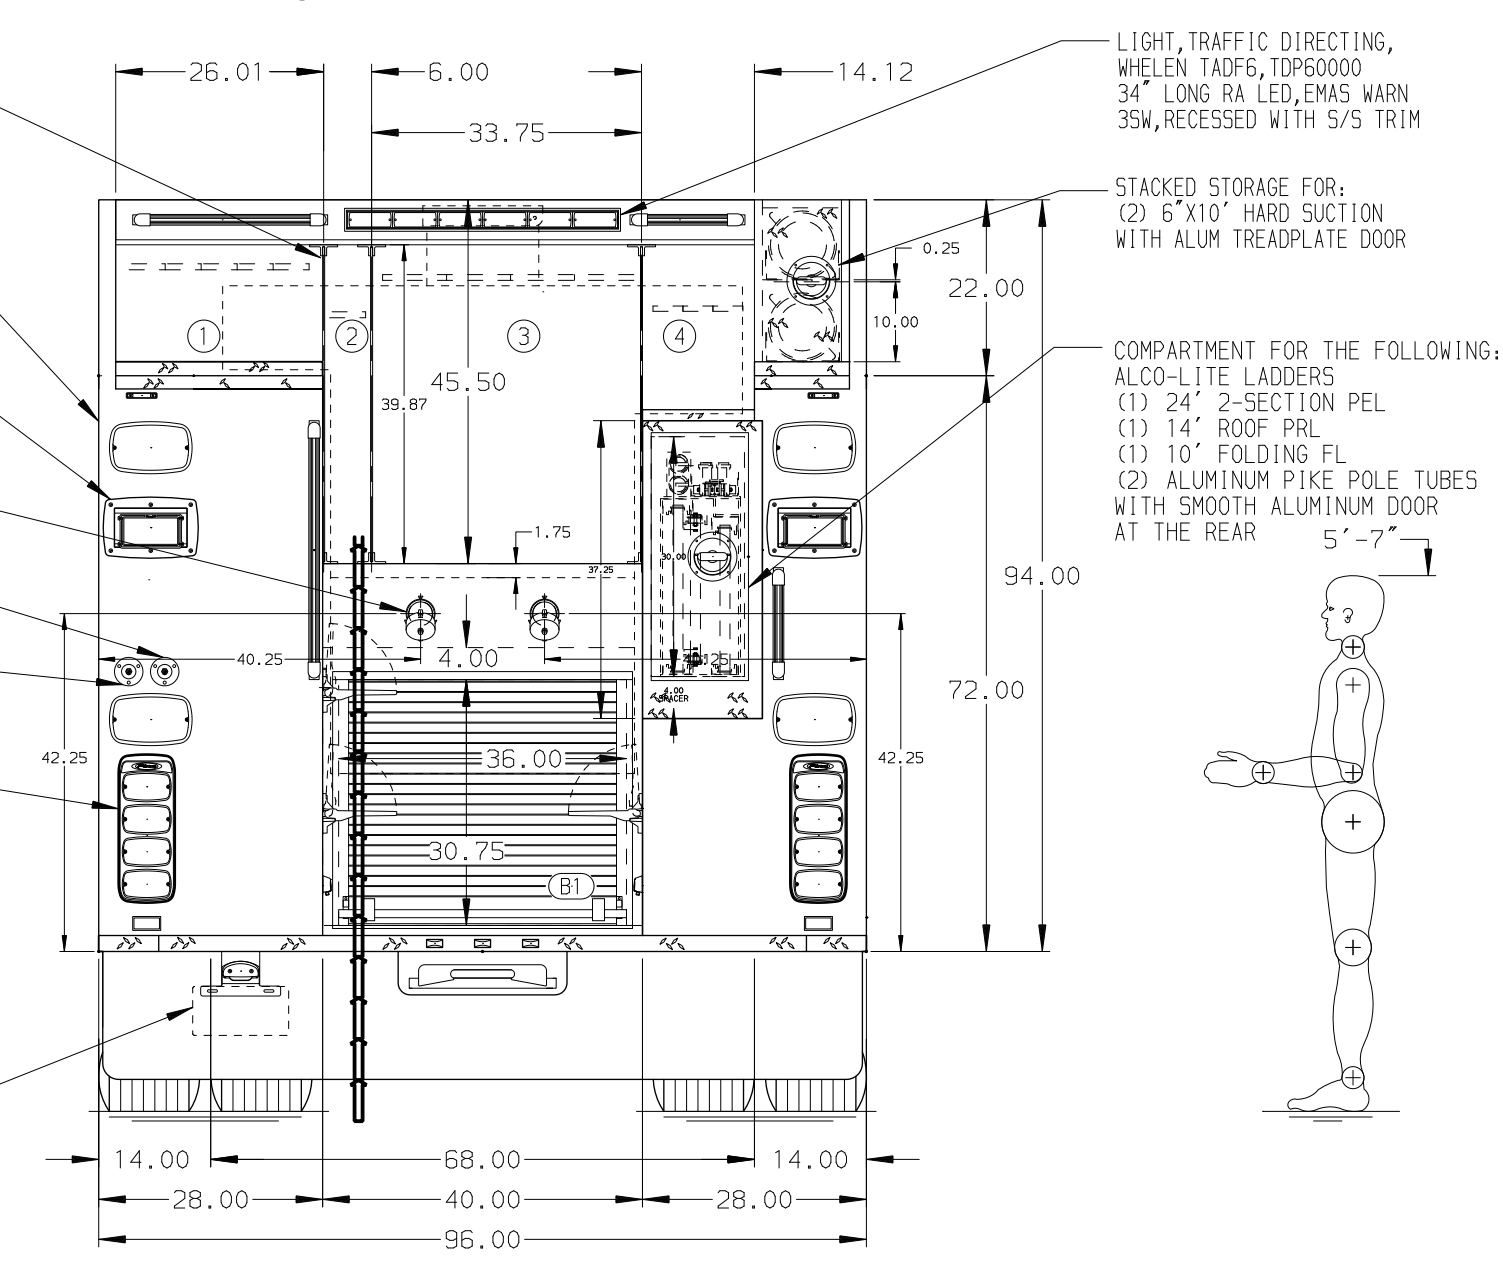


- HOSEBED CAPACITIES
- ① - 400' OF 2.50" D.J. POLY HOSE
 - ② - 250' OF 2.50" D.J. POLY HOSE (SINGLE STACK)
 - ③ - 1200' OF 5.00" D.J. POLY HOSE
 - ④ - 300' OF 2.00" D.J. POLY HOSE

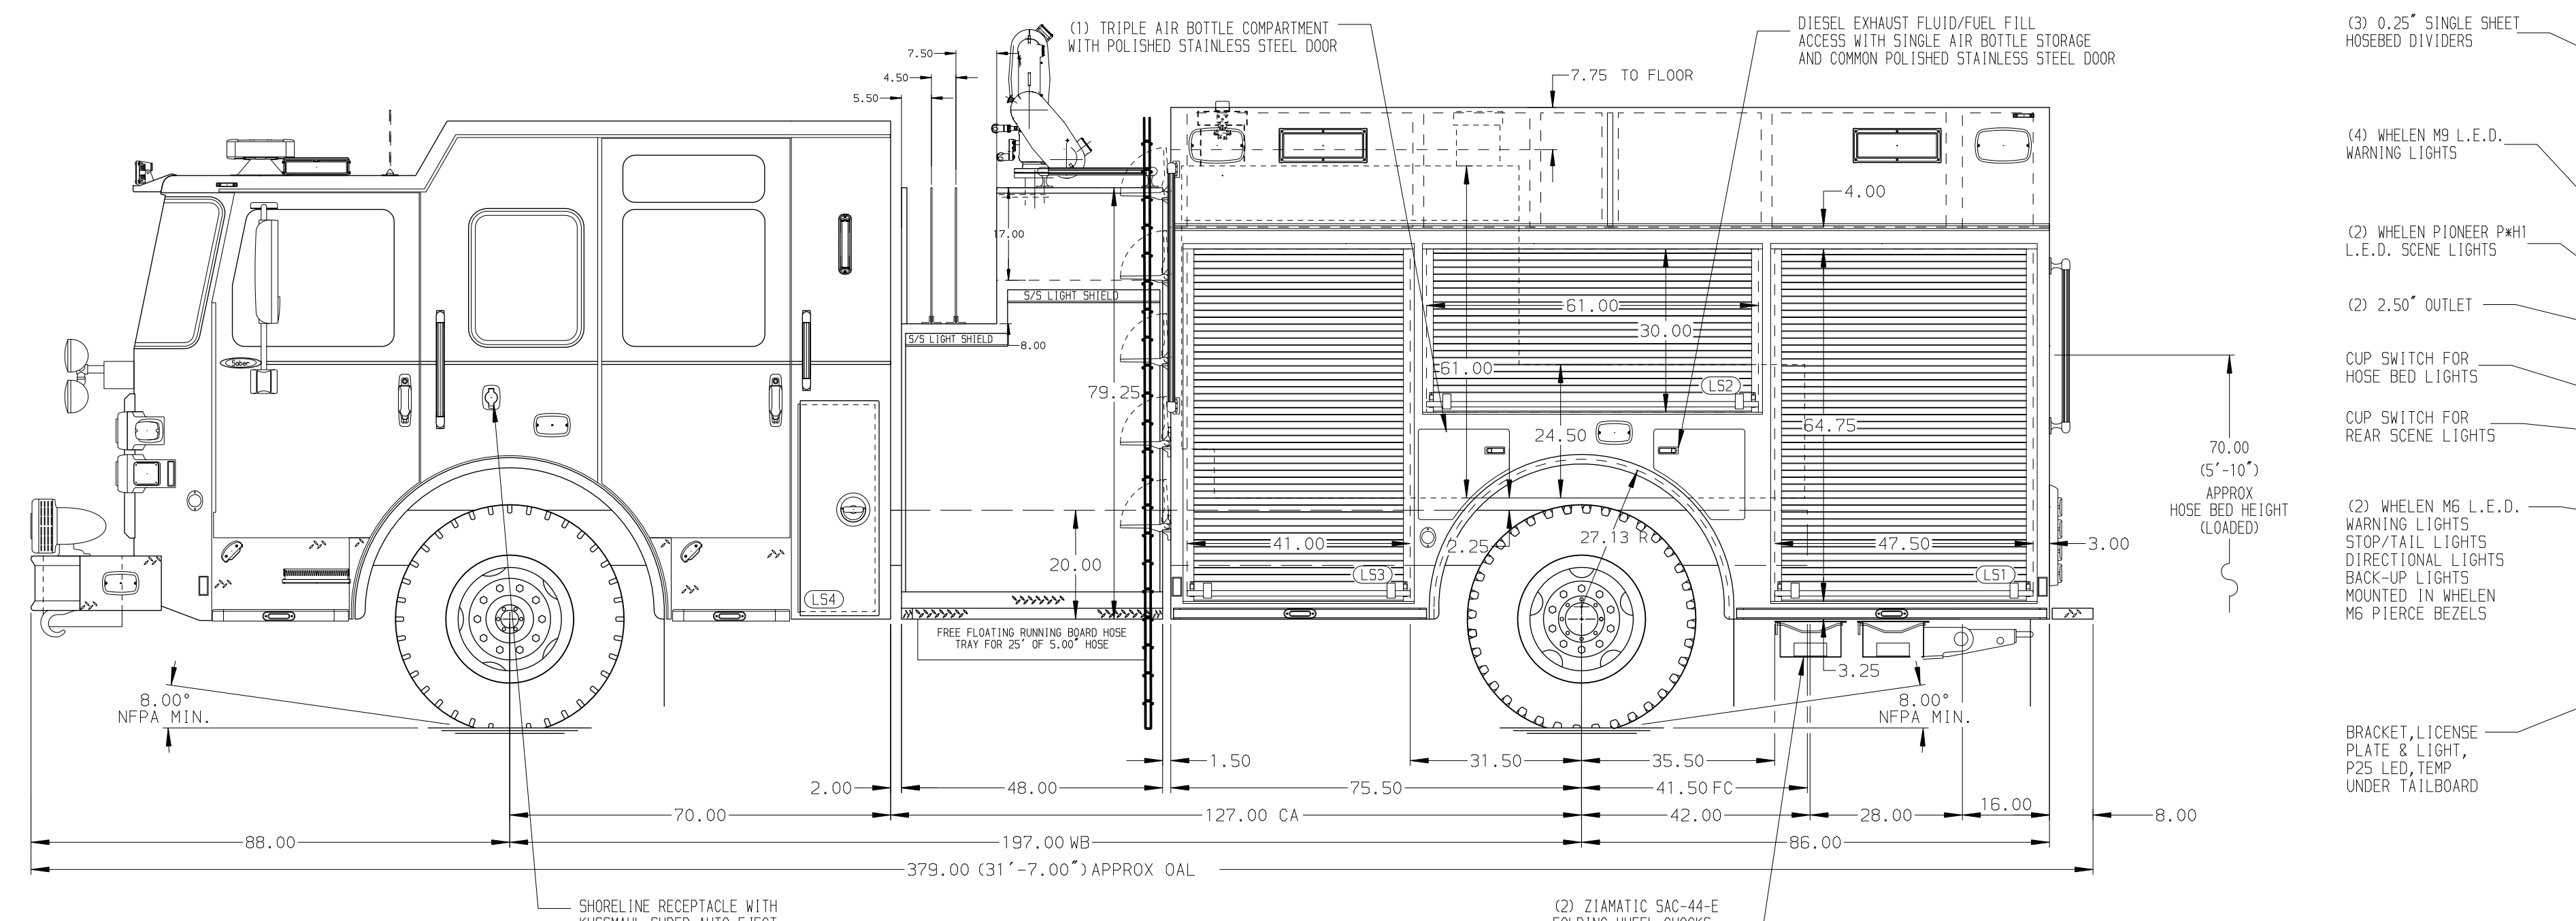

ALUMINUM BODY

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

		JOB NO.	39987
		SCALE	DATE
		1:24	
		DRAWN BY	29SEP23
		JJB	
		CHECKED BY	29SEP23
		EGO	
		SHEET SIZE	SHEET NO.
		D	1 OF 1

CHASSIS DATA
 TITLE 1500-D-780P, 750G WATER, 30G FOAM, 161" FDLER PUMPER LADDERS BTWN TANK & SS, (3) CROSSLAYS, DELUGE
 MAKE CAROMI FIRE DEPARTMENT
 FOR LADSON, SOUTH CAROLINA
 DWG NO. 39987AD

REV	DATE	BY	CH	SABER FR
15FEB24	RWR	JAP		
21NOV23	RWR	JAP		